



CITY OF DAYTON PLANNING DEPARTMENT
111 S. 1st Street, Dayton, WA 99328
(T) 509-540-6747 (F) 509.382.2539 Email: kscharer@daytonwa.com
www.DaytonWa.com

PUBLIC NOTICE
SEPA Threshold Determination of Nonsignificance (DNS)
FILE - SEPA15-011 / Water Systems Plan 2015

Date: July 23, 2015

To: Washington State Agencies, Tribes, local governmental agencies and community groups

Pursuant to Washington State Environmental Policy Act (SEPA), the City of Dayton is issuing this Notice of SEPA Threshold Determination of Nonsignificance (DNS).

Description of Proposal: The 2015 Water System Plan for the City of Dayton, WA, is a document covering all aspects of the City's water system. The plan includes projected water demands for the next 20 years (2014-2034) and identifies capital improvement projects that are needed over the next 20 years to meet the needs of Dayton. The plan covers physical facilities (wells, reservoirs, waterlines), operational plans, source water protection, financial status of the water system, and projected costs of the improvements. The area covered under this plan is the City's existing, retail, future, and water rights place of use water service areas.

Proponent & Lead agency: City of Dayton

Responsible official – Karen Scharer, Planning Director (contact as listed above)

Location: Water System Area Wide - Dayton, WA (see map attached) The location of the proposal encompasses the City's existing, retail, future, and water rights place of use water service areas. The above water service areas include the City limits, the majority of the Urban Growth Area (UGA), and existing services outside the UGA. Portions of the UGA were excluded from the City's water service areas due to existing topography and water features.


WSP & Environmental Documents: Copies of the WSP and following documents are available for review at www.daytonwa.com or contact the City at the above address.

APPENDICES

Appendix A - Background Water System Information
Appendix B - Correspondence and Supportive Documents
Appendix C - Water Usage Data
Appendix D - System Analysis Information
Appendix E - WUE and Water Rights Documentation
Appendix F - Wellhead Protection Plan
Appendix G - O&M Information
Appendix H - Financial Data
Appendix I - Environmental Information

SEPA: The lead agency for this proposal has determined that the proposal does not have a probable significant adverse impact on the environment. An environmental impact statement (EIS) is not required under RCW 43.21C.030 (2)(c). This decision was made after review of a completed environmental checklist and other information on file with the lead agency. This information is available to the public on request. This DNS is issued under WAC 197-11-340(2); the lead agency will not act on this proposal until appeals are concluded.


Comments and/or appeals: Comments and/or appeals of the DNS must be filed before 4 pm, August 6, 2015 at the address listed above. See DMC Title 10-06.040 for filing procedures.

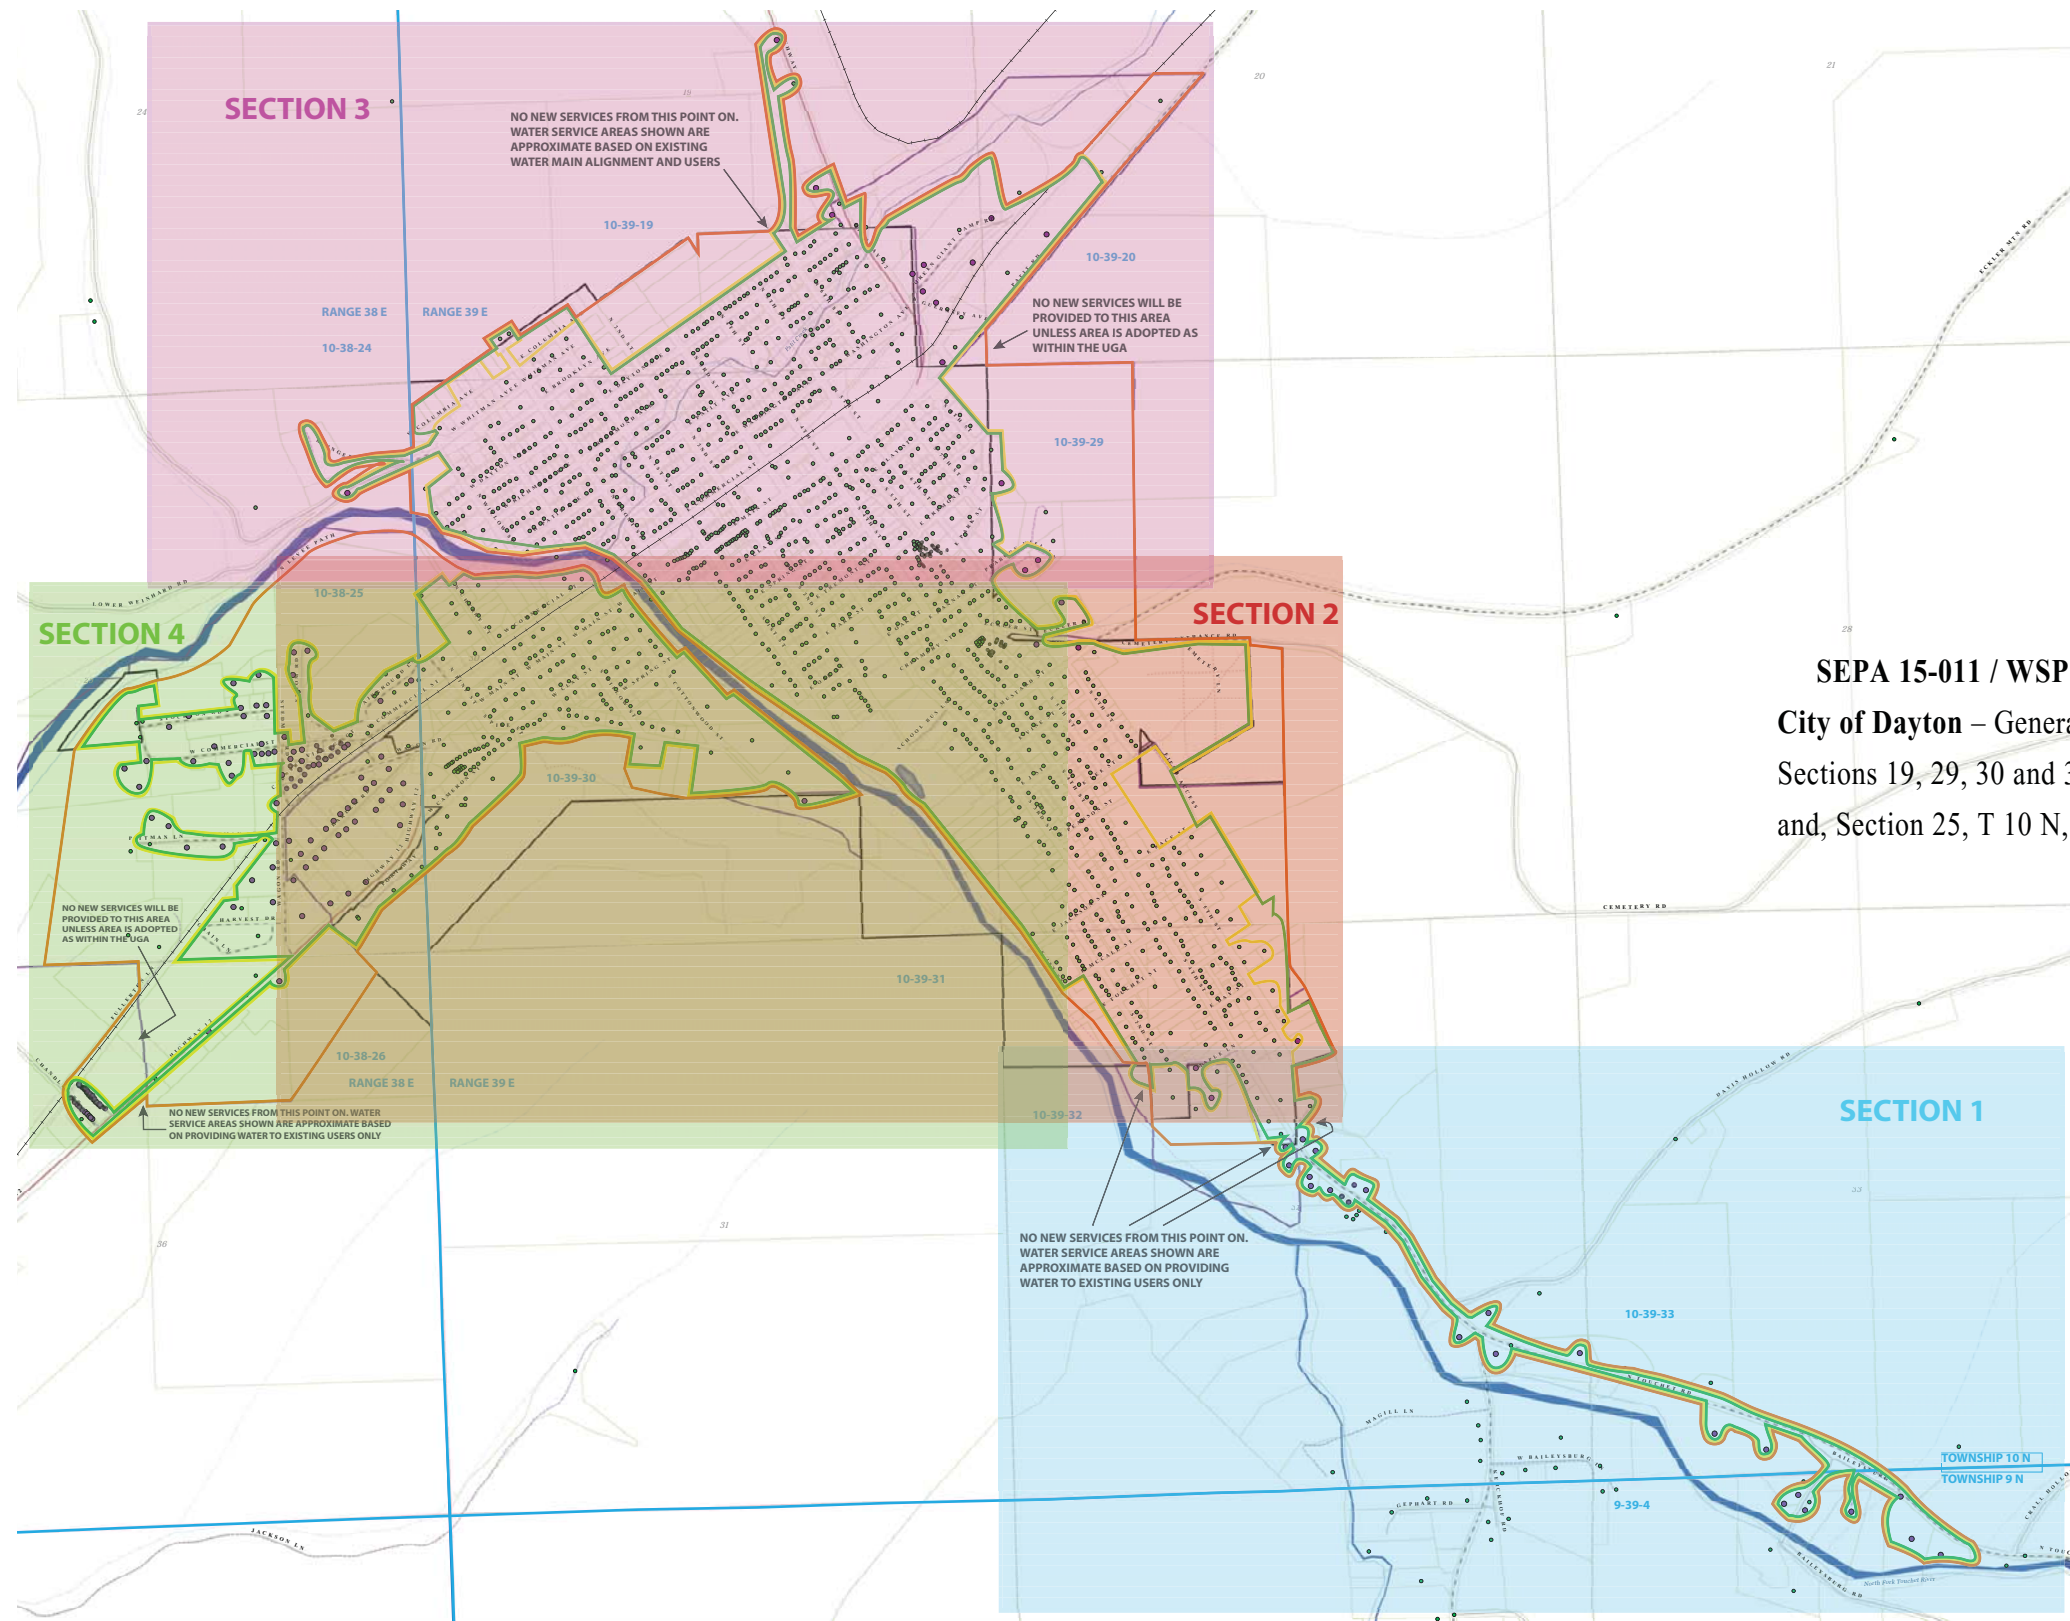

SEPA 15-011 / WSP UPDATE
City of Dayton – Generally located in
 Sections 19, 29, 30 and 32, T 10 N, R 39 E;
 and, Section 25, T 10 N, R 38 E

LEGEND

- EXISTING SERVICE AREA (ESA)
 - RETAIL SERVICE AREA (RSA)
 - CITY LIMITS
 - URBAN GROWTH AREA (UGA)
 - FUTURE SERVICE AREA (FSA) AND WATER RIGHTS PLACE OF USE SERVICE AREA (WRPOUSA)
 - TOWNSHIP - RANGE - SECTION
- NOTE:** CITY LIMITS AND UGA BOUNDARY LINES ARE SHOWN UNDER THE SERVICE AREA LINES AND MAY NOT ALWAYS BE VISIBLE



CITY OF
DAYTON, WASHINGTON
 WATER SYSTEM PLAN
 WATER SERVICE AREA MAP
 OVERALL VIEW

FIGURE
1-4